


BACKFILL IN PAVED AREAS SHALL BE
CRUSHED STONE. SEE SPECIFICATIONS.

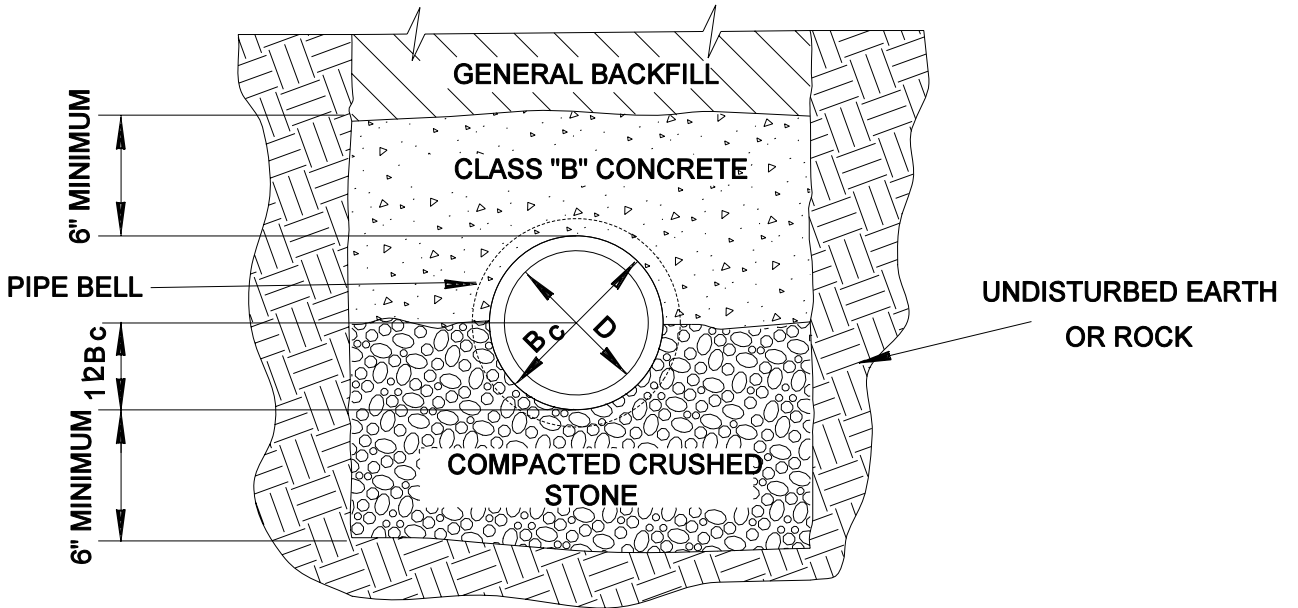

NOTES:

- 1) DETAILS ARE APPLICABLE TO BOTH EARTH AND ROCK TRENCHES.
- 2) COMPACTED CRUSHED STONE SHALL BE SIZE NO. 67 AS GIVEN IN SECTION 903 OF THE T.D.O.T. STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.

DRAWING NOT TO SCALE

DECEMBER 31, 1994

DRAWN BY: M.H. & A.H.W.F.

APPROVED BY: K.N.H.

CONCRETE ARCH ENCASEMENT

STANDARD
DRAWING NO.

W - 4

MURFREESBORO WATER & SEWER DEPARTMENT