


# PRECAST CONCRETE GRAVITY GREASE INTERCEPTOR WITH SAMPLING PORT

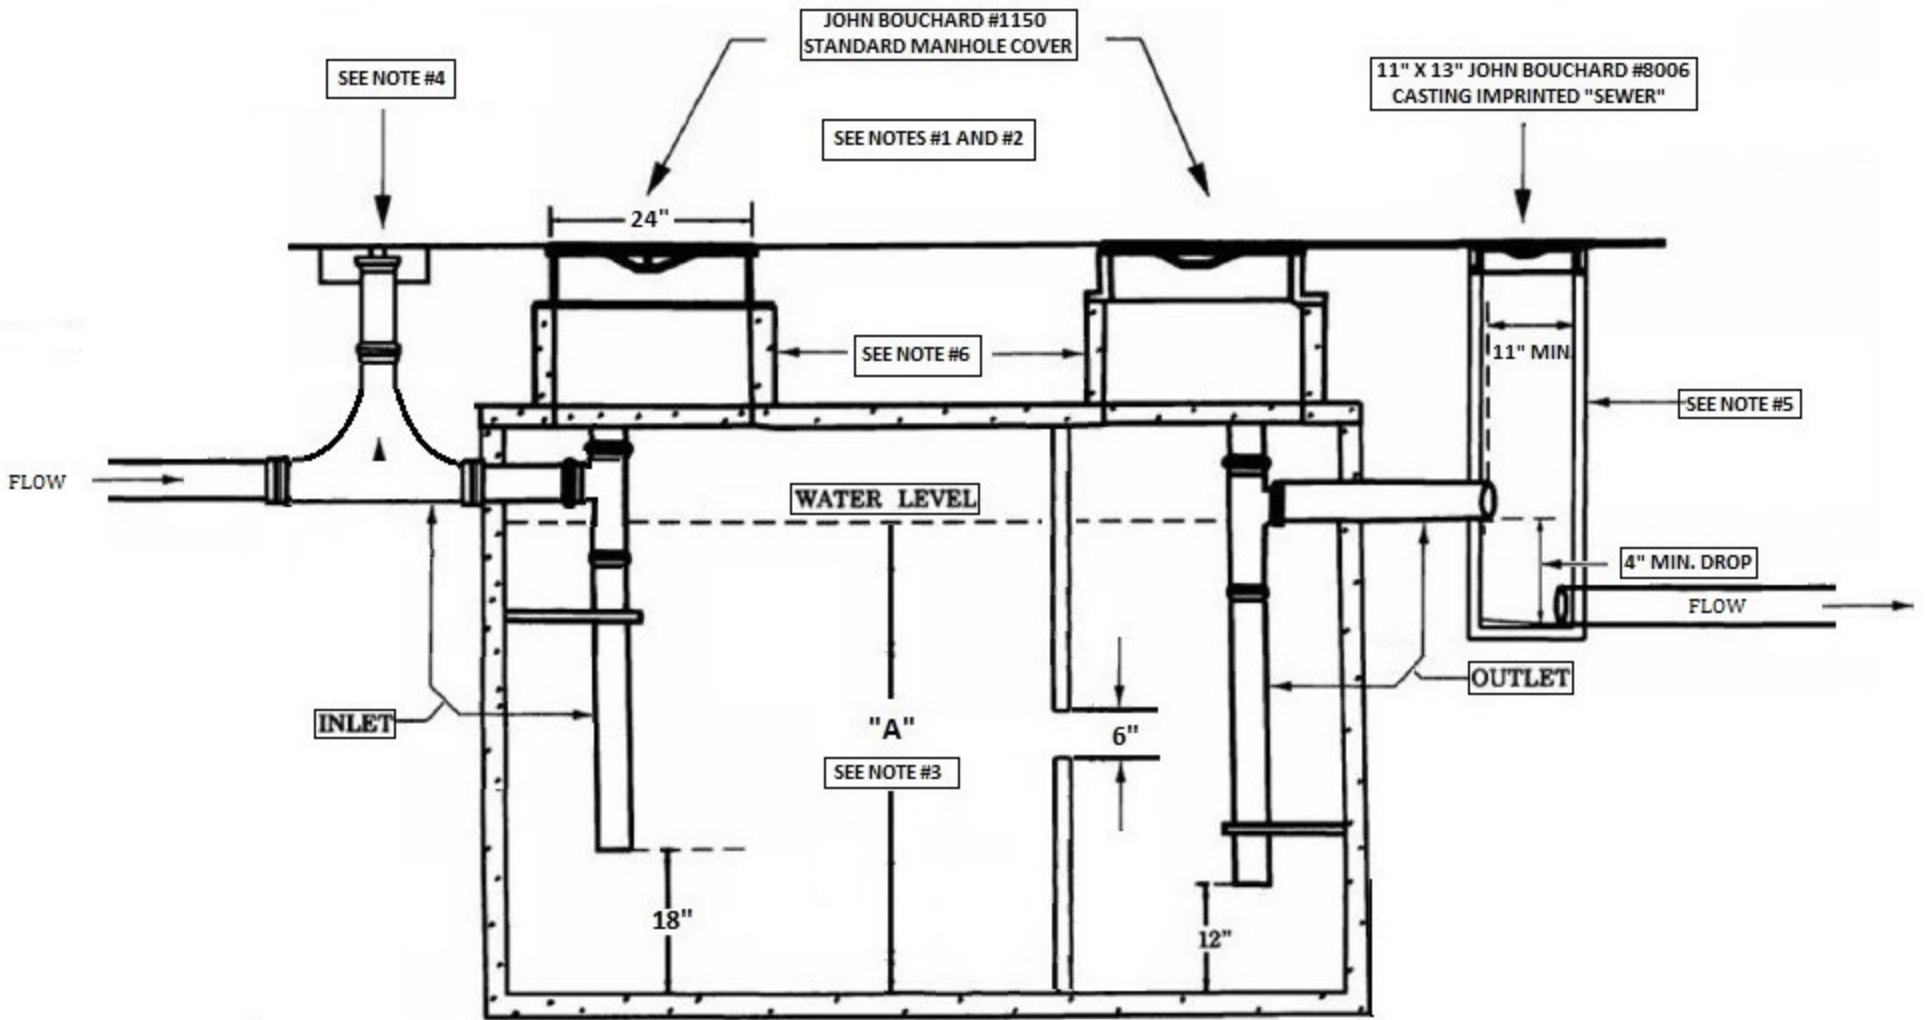

- NOTES:**
1. CONCRETE TANKS MUST BE PRECAST MONOLITHIC UNITS WITH THE LID ATTACHED ABOVE THE PIPE PENETRATIONS.
  2. THE MAXIMUM CAPACITY FOR ANY SINGLE TANK IS 2,000 GALLONS. SECONDARY TANKS MUST BE CONNECTED IN SERIES IF ADDITIONAL CAPACITY IS REQUIRED.
  3. "A" = THE CENTERLINE FROM THE BOTTOM OF THE OUTLET TO THE TANK FLOOR WITH THE BAFFLE WALL OPENING CENTERED ON DIMENSION "A". THE MINIMUM HEIGHT OF THE OPENING IS SIX (6) INCHES.
  4. ALL GREASE INTERCEPTORS MUST INCLUDE A TWO-WAY COMBINATION TEE CLEANOUT ON THE INLET SIDE OF THE TANK.
  5. ALL GREASE INTERCEPTORS MUST BE EQUIPPED WITH A SAMPLING PORT. SAMPLING PORTS MUST BE MOLDED OR PRECAST AS A MONOLITHIC UNIT. FIELD CUT TO ESTABLISH FINAL GRADE.
  6. MANHOLE FRAME RISERS MUST BE PRECAST AS A MONOLITHIC UNIT. FIELD CUT TO ESTABLISH FINAL GRADE.